


GENERAL NOTES (BIOSWALE):

1. VEGETATION SHOULD BE OFFSET A MINIMUM OF 5 FEET FROM CONCENTRATED FLOW.
2. SELECTED LANDSCAPE PLANTS SHOULD BE DROUGHT TOLERANT AND IN ACCORDANCE WITH SECTION 795.7.
3. DRIP IRRIGATION **SHALL** BE PROVIDED BY A TEMPORARY OR PERMANENT IRRIGATION SYSTEM.
4. DO NOT PLANT OVER UNDERDRAIN (IF INSTALLED).

BIOSWALE SECTION

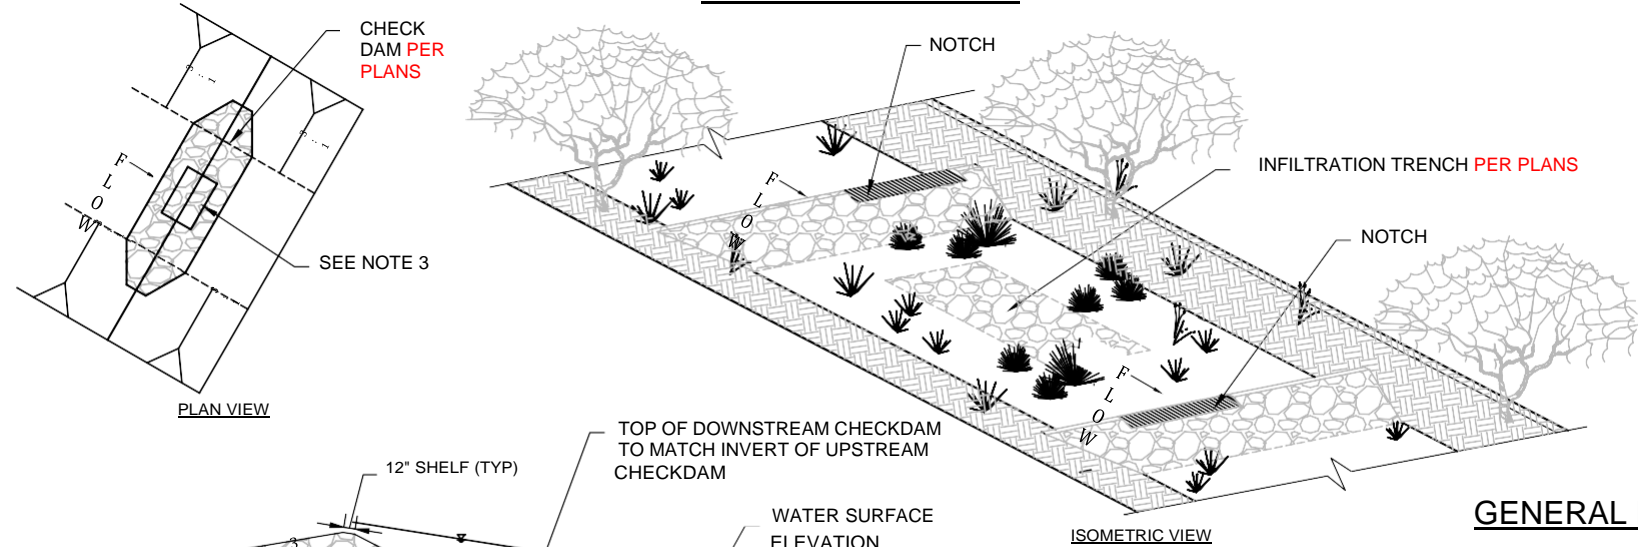

GENERAL NOTES (CHECK DAM):

1. ROCK CHECK DAM (IF INSTALLED) SHALL DISPERSE HIGH FLOWS AND BE INSTALLED IN ACCORDANCE WITH SECTION 640.3.3 AND THE PROJECT PLANS/SPECIFICATIONS.
2. RIPRAP SHALL BE IN ACCORDANCE WITH SECTION 644.
3. NOTCHES SHALL BE OFFSET FEET FROM ONE ANOTHER.
4. A DEDICATED OUTFLOW SHALL BE INSTALLED AS SHOWN ON THE PROJECT PLANS/SPECIFICATIONS.

OPTIONAL ROCK CHECK DAM